


Données relatives à l'échantillon prélevé	
Date	20.09.2007
Emplacement	Epines
effectué par:	Labo de la construction
Remarques:	en stock Epines

Courbe analysée		
0/50 Klem	no. 19	0%
G1 Epines	no. 22	100%
examen de qualification selon fuseaux restreints, fr1 et fr2		

Tamis	mélange
mm	39345.00
0.063	1.80
0.08	2.20
0.10	2.60
0.125	3.00
0.16	3.33
0.20	3.67
0.25	4.00
0.32	5.67
0.40	7.33
0.50	9.00
0.63	11.67
0.80	14.33
1.00	17.00
1.25	19.00
1.60	21.00
2.00	23.00
2.50	25.00
3.15	27.00
4.00	29.00
5.00	32.33
6.30	35.67
8.00	39.00
10.00	44.33
12.50	49.67
16.00	55.00
20.00	62.00
25.00	69.00
31.50	76.00
45.00	91.00
63.00	100.00
90.00	100.00

Courbe de composition de la grave selon SN 670 120c

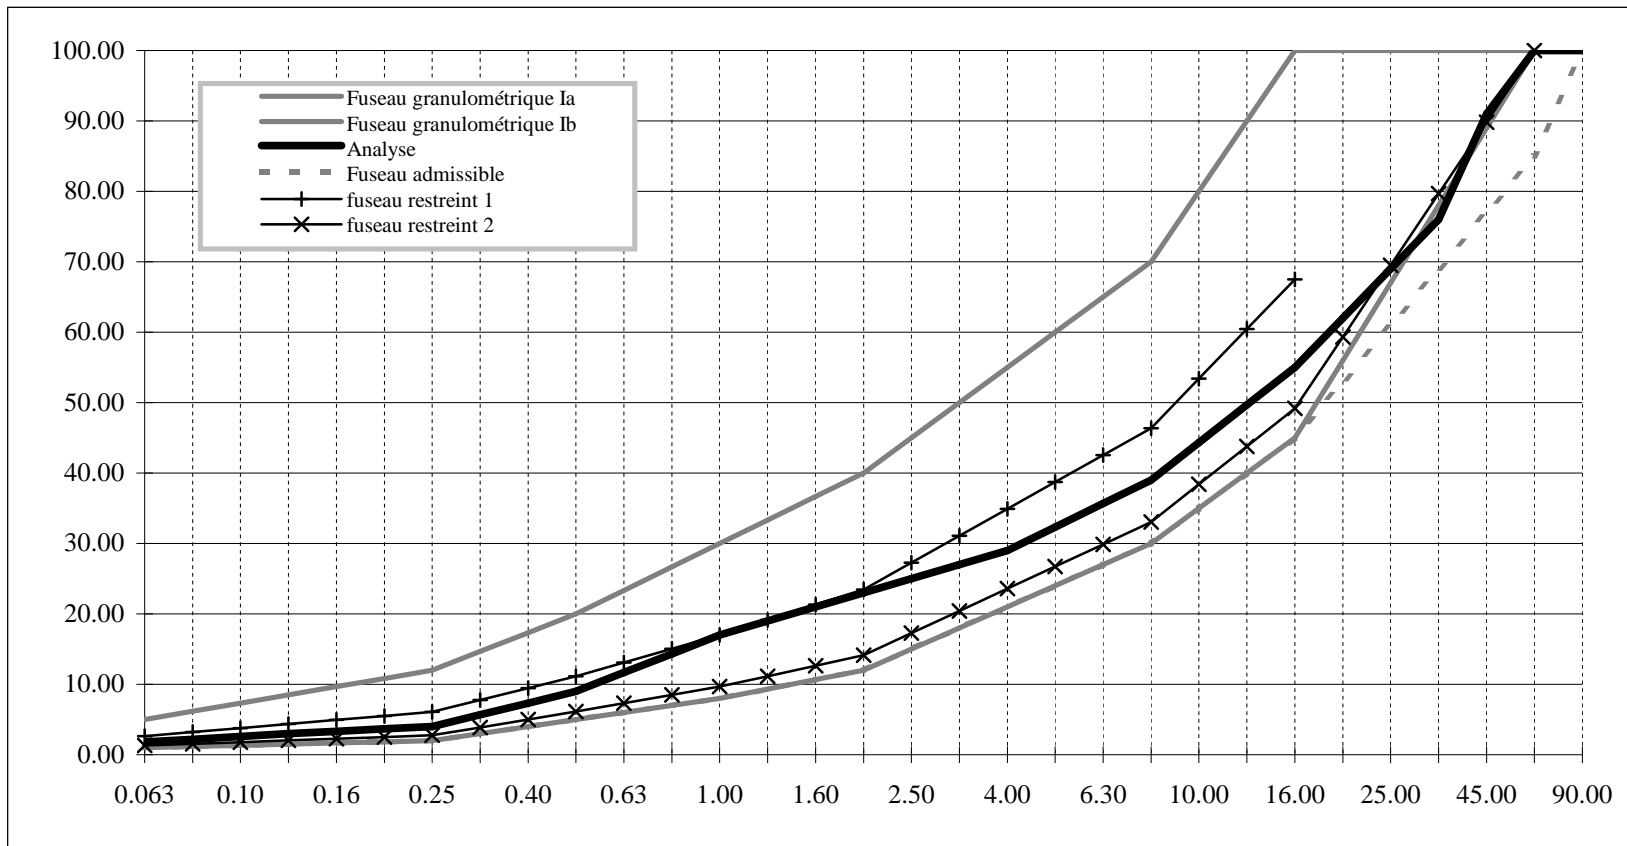

courbe et explicatifs disponibles sur www.genetti.ch, compléments aux examens de qualification sur demande